



Tina Hendrix, P.A. - AUDIOLOGIST, MA, CCC-A

Telephone: 501-622-9373 - FAX: 501-683-8219 - Email: thehearinglady501@gmail.com

Individual: Willow King

Center: FS Glenwood

Date: 03/13/2023

| Otoacoustic Emissions (OAE) | | | |
|-----------------------------|-------------------|---------------|--------------|
| DB level | DB level | Results Right | Results Left |
| 25dB (65/55) | 2000Hz- 5000Hz | P | P |
| 50dB (70/70) | 2000Hz- 5000Hz | | |


| Tympanometry | |
|--------------|------|
| Ear | Type |
| Right | A |
| Left | A |

| Scale | |
|-------|----------------|
| DNT | Did Not Test |
| R | Right Ear |
| CNT | Could Not Test |
| L | Left Ear |
| B | Both Ears |

| Results and Recommendations |
|-----------------------------|
| Pass |

| |
|---|
| Passed OAE and Tympanometry Testing for both ears. |
|---|

Tina Hendrix
Tina Hendrix, M.A., CCC-A

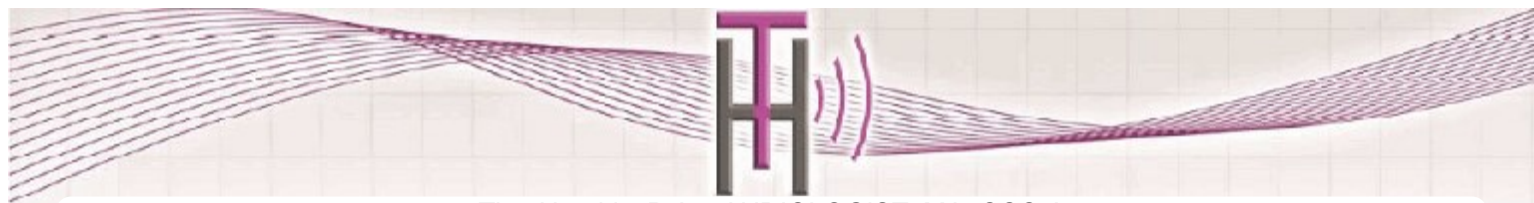

Tina Hendrix, P.A. - AUDIOLOGIST, MA, CCC-A

Telephone: 501-622-9373 - FAX: 501-683-8219 - Email: thehearinglady501@gmail.com

Individual: Alieaith Neighbors

Center: FS Glenwood

Date: 03/13/2023

| Otoacoustic Emissions (OAE) | | | |
|-----------------------------|-------------------|---------------|--------------|
| DB level | DB level | Results Right | Results Left |
| 25dB (65/55) | 2000Hz- 5000Hz | P | P |
| 50dB (70/70) | 2000Hz- 5000Hz | | |

| Tympanometry | |
|--------------|------|
| Ear | Type |
| Right | A |
| Left | A |

| Scale | |
|-------|----------------|
| DNT | Did Not Test |
| R | Right Ear |
| CNT | Could Not Test |
| L | Left Ear |
| B | Both Ears |

| Results and Recommendations |
|-----------------------------|
| Pass |

| |
|---|
| Passed OAE and Tympanometry Testing for both ears. |
|---|

Tina Hendrix
Tina Hendrix, M.A., CCC-A



Tina Hendrix, P.A. - AUDIOLOGIST, MA, CCC-A

Telephone: 501-622-9373 - FAX: 501-683-8219 - Email: thehearinglady501@gmail.com

Individual: Ryder Alger

Center: FS Glenwood

Date: 03/13/2023

| Otoacoustic Emissions (OAE) | | | |
|-----------------------------|-------------------|---------------|--------------|
| DB level | DB level | Results Right | Results Left |
| 25dB (65/55) | 2000Hz- 5000Hz | F | F |
| 50dB (70/70) | 2000Hz- 5000Hz | | |

| Tympanometry | |
|--------------|------|
| Ear | Type |
| Right | B |
| Left | B |


| Scale | |
|-------|----------------|
| DNT | Did Not Test |
| R | Right Ear |
| CNT | Could Not Test |
| L | Left Ear |
| B | Both Ears |

Results and Recommendations

Rescreen in 3 Weeks.

Failed OAE Testing and had abnormal Tympanometry results which may indicate: (Both Ears) Possible middle ear fluid: (BOTH EARS)

Tina Hendrix
Tina Hendrix, M.A., CCC-A

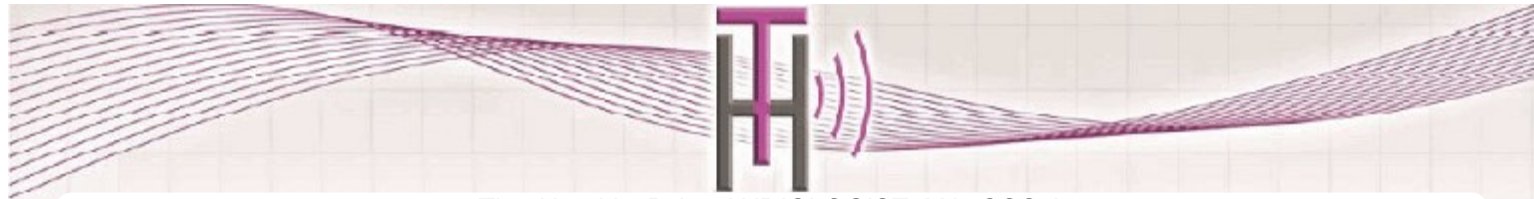

Tina Hendrix, P.A. - AUDIOLOGIST, MA, CCC-A

Telephone: 501-622-9373 - FAX: 501-683-8219 - Email: thehearinglady501@gmail.com

Individual: Jacob Gaitan

Center: FS Glenwood

Date: 03/13/2023


| Otoacoustic Emissions (OAE) | | | |
|-----------------------------|-------------------|---------|--------------|
| DB level | DB level | Results | Results Left |
| | | Right | |
| 25dB (65/55) | 2000Hz- 5000Hz | | |
| 50dB (70/70) | 2000Hz- 5000Hz | | |

| Tympanometry | |
|--------------|------|
| Ear | Type |
| Right | A |
| Left | A |

| Scale | |
|-------|----------------|
| DNT | Did Not Test |
| R | Right Ear |
| CNT | Could Not Test |
| L | Left Ear |
| B | Both Ears |

Results and Recommendations

Tina Hendrix
Tina Hendrix, M.A., CCC-A

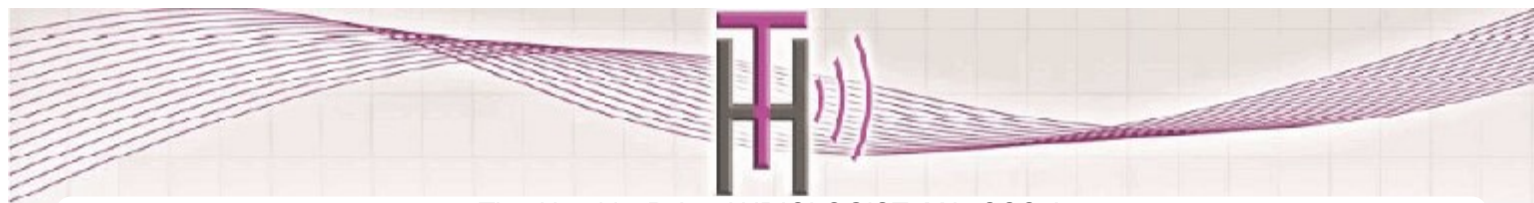

Tina Hendrix, P.A. - AUDIOLOGIST, MA, CCC-A

Telephone: 501-622-9373 - FAX: 501-683-8219 - Email: thehearinglady501@gmail.com

Individual: James Summitt

Center: FS Glenwood

Date: 03/13/2023

| Otoacoustic Emissions (OAE) | | | |
|-----------------------------|-------------------|---------------|--------------|
| DB level | DB level | Results Right | Results Left |
| 25dB (65/55) | 2000Hz- 5000Hz | F | P |
| 50dB (70/70) | 2000Hz- 5000Hz | | |

| Tympanometry | |
|--------------|------|
| Ear | Type |
| Right | |
| Left | A |

| Scale | |
|-------|----------------|
| DNT | Did Not Test |
| R | Right Ear |
| CNT | Could Not Test |
| L | Left Ear |
| B | Both Ears |

Results and Recommendations

Rescreen in 3 Weeks.

Failed OAE Testing and had abnormal Tympanometry results which may indicate: (Both Ears) </br> Possible middle ear fluid: (RIGHT EAR) Drainage present in ear canal: (RIGHT EAR)

Tina Hendrix
Tina Hendrix, M.A., CCC-A



Tina Hendrix, P.A. - AUDIOLOGIST, MA, CCC-A

Telephone: 501-622-9373 - FAX: 501-683-8219 - Email: thehearinglady501@gmail.com

Individual: Jaylynn Howard

Center: FS Glenwood

Date: 03/13/2023

| Otoacoustic Emissions (OAE) | | | |
|-----------------------------|-------------------|---------------|--------------|
| DB level | DB level | Results Right | Results Left |
| 25dB (65/55) | 2000Hz- 5000Hz | | F |
| 50dB (70/70) | 2000Hz- 5000Hz | | |


| Tympanometry | |
|--------------|------|
| Ear | Type |
| Right | A |
| Left | B |

| Scale | |
|-------|----------------|
| DNT | Did Not Test |
| R | Right Ear |
| CNT | Could Not Test |
| L | Left Ear |
| B | Both Ears |

Results and Recommendations
Rescreen in 3 Weeks.

Failed OAE Testing and had abnormal Tympanometry results which may indicate: (Left Ear) Possible middle ear fluid: (LEFT EAR)

Tina Hendrix
Tina Hendrix, M.A., CCC-A

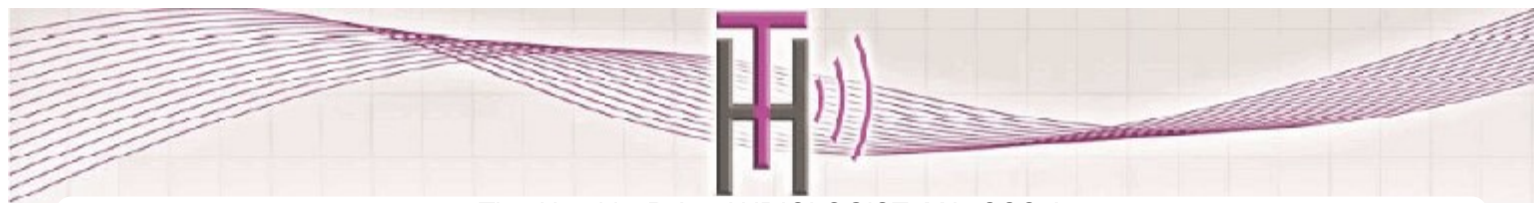

Tina Hendrix, P.A. - AUDIOLOGIST, MA, CCC-A

Telephone: 501-622-9373 - FAX: 501-683-8219 - Email: thehearinglady501@gmail.com

Individual: Clayton Smith

Center: FS Glenwood

Date: 03/13/2023

| Otoacoustic Emissions (OAE) | | | |
|-----------------------------|-------------------|---------------|--------------|
| DB level | DB level | Results Right | Results Left |
| 25dB (65/55) | 2000Hz- 5000Hz | P | P |
| 50dB (70/70) | 2000Hz- 5000Hz | | |

| Tympanometry | |
|--------------|------|
| Ear | Type |
| Right | A |
| Left | A |

| Scale | |
|-------|----------------|
| DNT | Did Not Test |
| R | Right Ear |
| CNT | Could Not Test |
| L | Left Ear |
| B | Both Ears |

| Results and Recommendations |
|-----------------------------|
| Pass |

| |
|---|
| Passed OAE and Tympanometry Testing for both ears. |
|---|

Tina Hendrix
Tina Hendrix, M.A., CCC-A